





**FT. MYERS, FLORIDA POST OFFICE
INSTALLATION AUGUST 27, 1999**

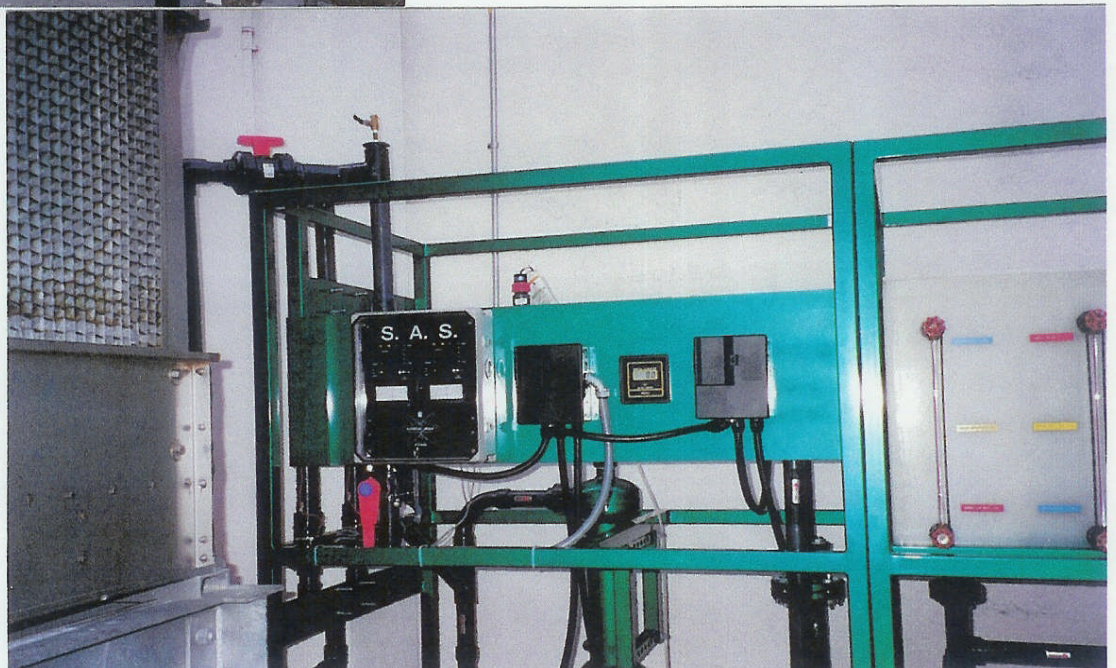

FT. MYERS, FLORIDA POST OFFICE
700 TONS/COMFORT AIR COOLING TOWERS
MODEL CT-400-ZB ENVIRONMENTALIST/ZERO-BLEED-2000
INSTALLED AUGUST 27, 1999

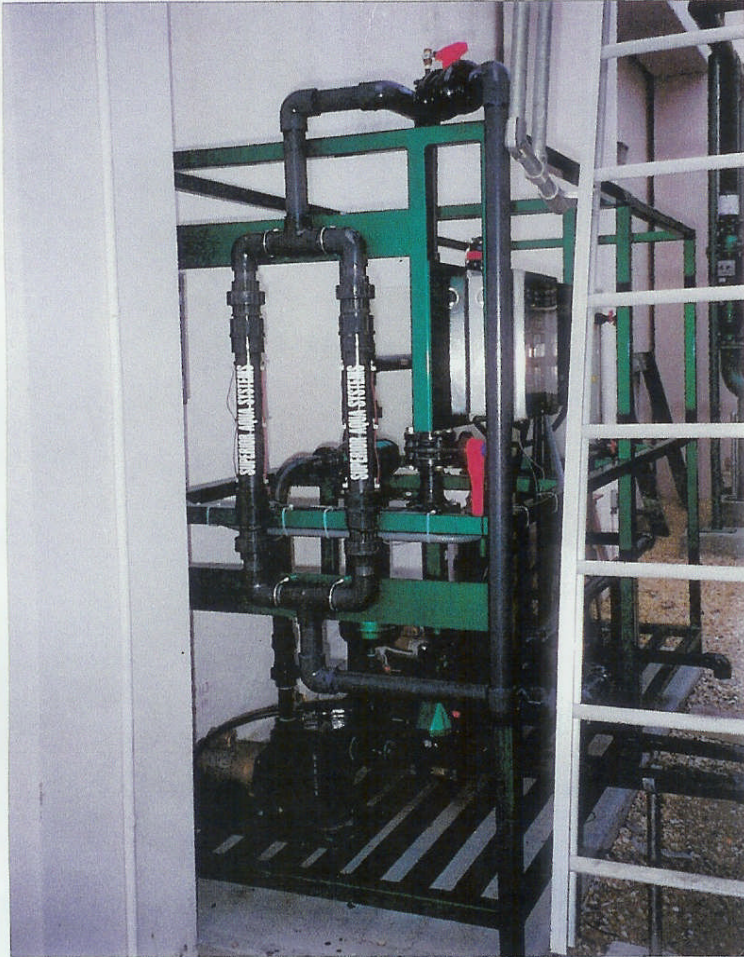



FT. MYERS, FLORIDA POST OFFICE

700 TONS/COMFORT AIR COOLING TOWERS

- (3) MODEL RT-1000-K SUPERIOR WATER CONDITIONERS (FWMU)**
 - (3) MODEL ACV-6-K SUPERIOR WATER CONDITIONERS (RECIRC)**
 - MODEL CT-400-ZB ENVIRONMENTALIST/ZERO-BLEED-2000**
- INSTALLED AUGUST 27, 1999**





J-B SUPPLY CO.

P.O. Box 897
BRANDON, FL 33509
(813) 689-5965
(800) 330 5965
FAX (813) 689-9598

"FOR SERVICE
OTHERS ONLY PROMISE

Feb. 18, 2000

Charlie Sanderson
Superior Mfg. Div.
2015 S. Calhoun St.
Ft. Wayne, IN. 46802

Dear Charlie;

In August, 1999, a "Superior Water Conditioner, Zero Bleed®" system was installed on the 700 ton cooling tower at the Postal Service Distribution Center in Ft. Myers, FL.


On Feb. 14, 2000, I drove to Ft. Myers. About 8 AM, the chillers were opened for inspection by the maintenance personnel. The head mechanic that opened the chillers said that the chillers were cleaner than he had ever seen them.

John Wilson, Supervisor over the HVAC, agreed.

Ed Morgan, Supervisor of Maintenance Operations, was there and agreed that everything looked very good.

See photos of the chiller tubes and SWC on the towers inclosed.

Sincerely,



Jack Bernauer




SINCE 1964


U.S. and Foreign Patents

The Superior Solution to Hard Water Problems
Non-Chemical Water Treatment to Control Lime Scale

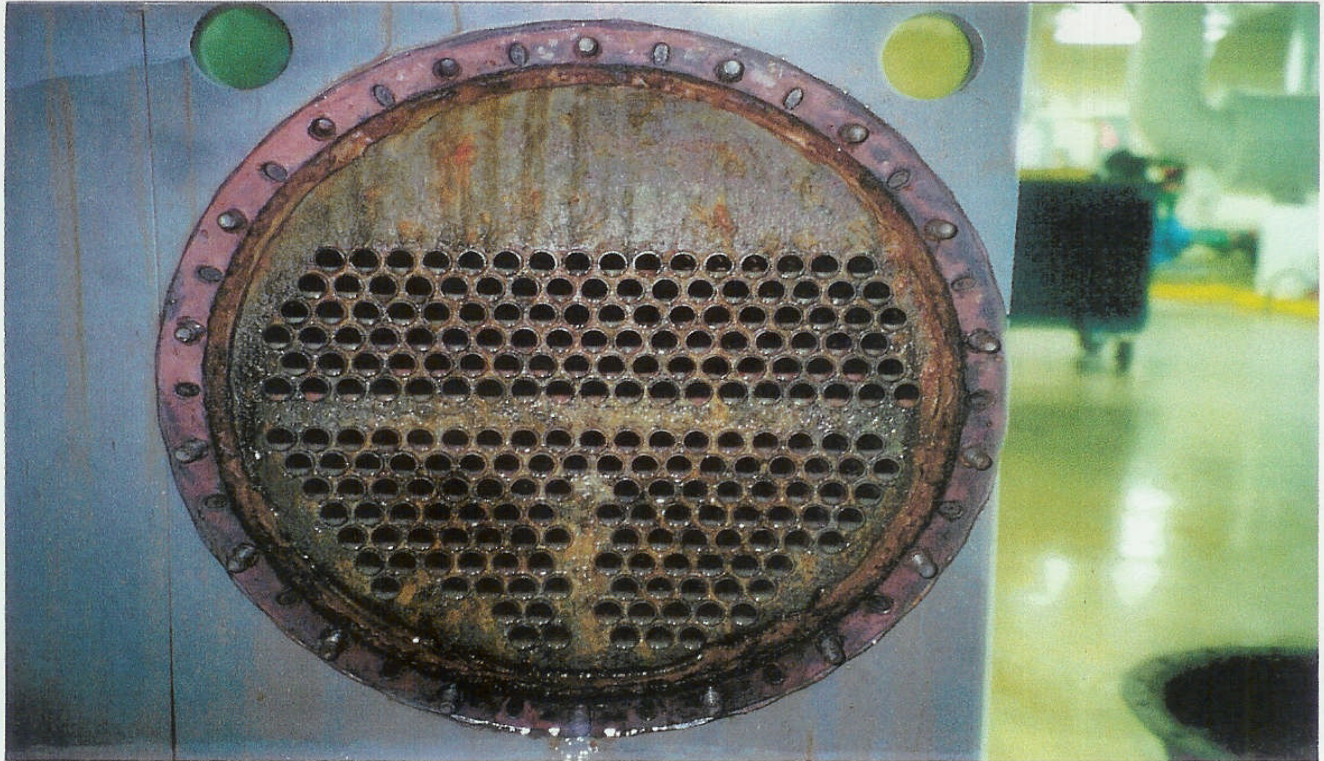


**FT. MYERS, FLORIDA POST OFFICE
700 TONS/COMFORT AIR COOLING TOWERS
SUPERIOR WATER TREATMENT SYSTEM
INSTALLED AUGUST 27, 1999
CHILLERS OPENED FEBRUARY 14, 2000**

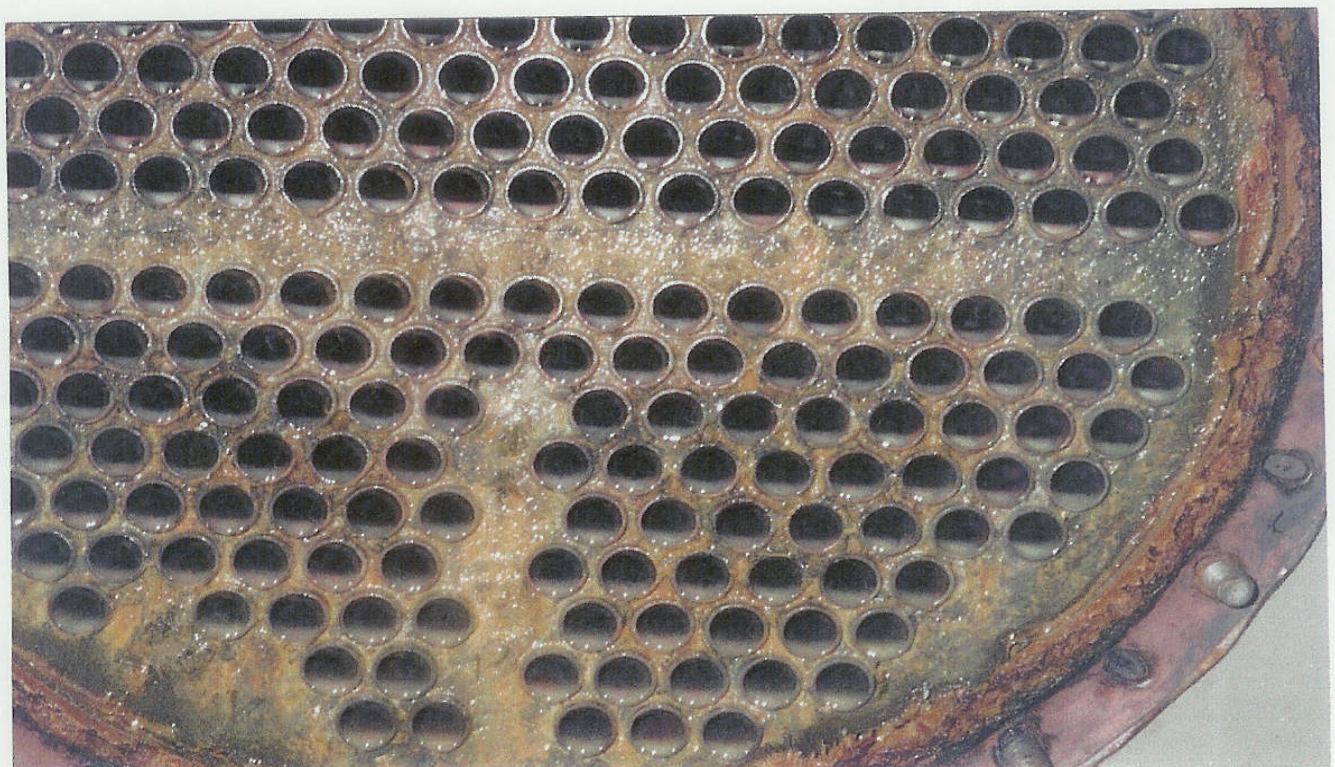

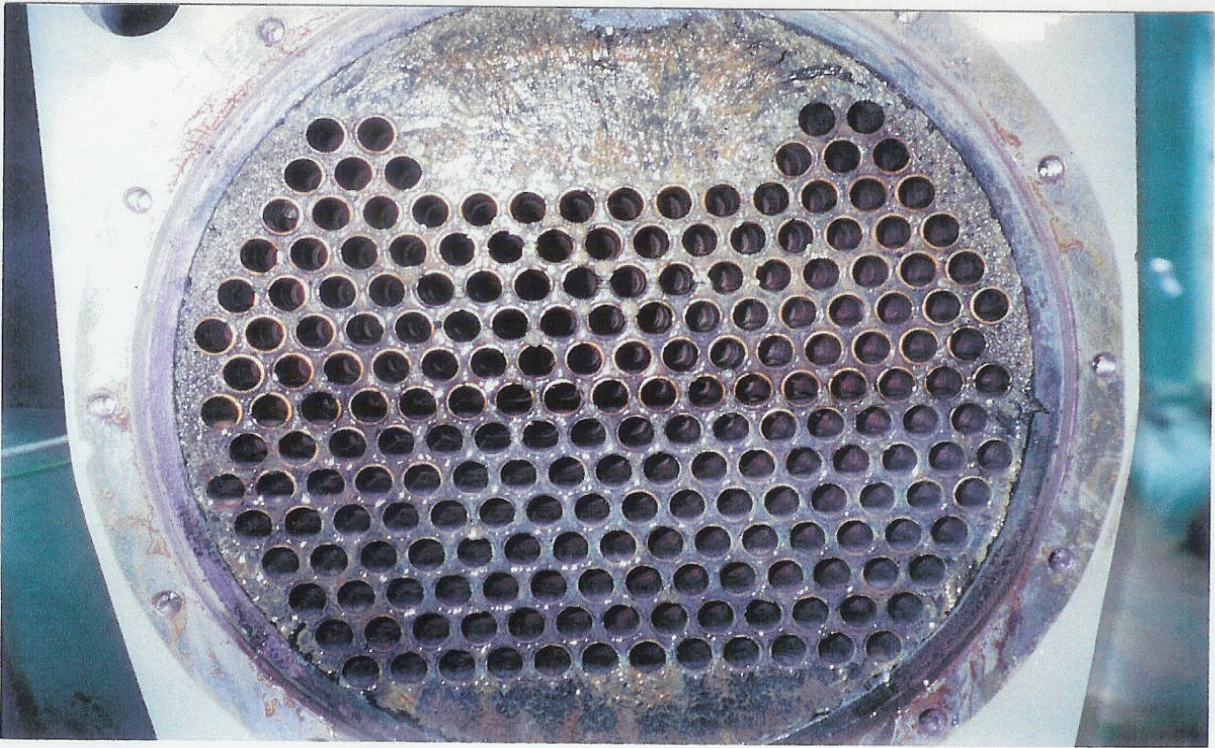

**FT. MYERS, FLORIDA POST OFFICE
700 TONS/COMFORT AIR COOLING TOWERS
SUPERIOR WATER TREATMENT SYSTEM
INSTALLED AUGUST 27, 1999
CHILLERS (RETURN END) OPENED FEBRUARY 14, 2000**

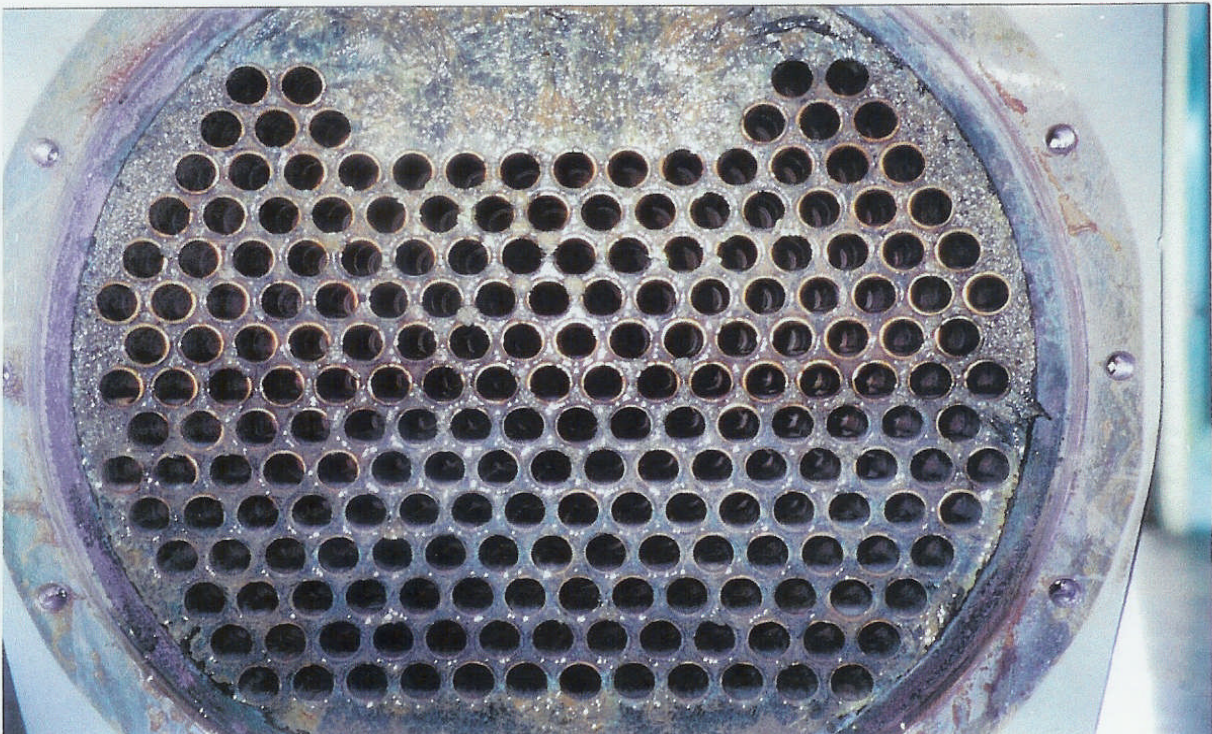



J-B SUPPLY CO.

P.O. Box 897
BRANDON, FL 33509
(813) 689-5965
(800) 330 5965
FAX (813) 689-9598

"FOR SERVICE
OTHERS ONLY PROMISE"

April 18, 2001

Charlie Sanderson
Superior Mfg. Div.
2015 S. Calhoun Street
Ft. Wayne, IN. 46802

Dear Charlie;

We had the opening of the Ft. Myers Post Office chillers yesterday. When I arrived, I found the strainer going to the controller and bleed blocked. The conductivity was beyond my meter of 5000. The FWMU is 110. Not knowing what we might find, I told everyone of the blockage and high conductivity.

Those attending were from the Tampa and Ft Lauderdale Post Office. Also the building maintenance supervisor from Alachua County, Gainesville, FL. The University of Florida is located in Gainesville. Everyone had a camera plus Alachua had a video camera.

Well, the chillers were opened (had my fingers crossed). They looked very good and everyone was surprised at the condition of the chillers. All but Ed Morgan of the Ft. Myers PO and me. Ed said the chillers looked good every time they were opened. The mechanic working on the chillers said that they always had scale before SWC was installed.

Everyone attending asked me to visit them and quote on their systems.

Photos in the mail.

Sincerely,

Jack Bernauer



SINCE 1964

U.S. and Foreign Patents

The Superior Solution to Hard Water Problems
Non-Chemical Water Treatment to Control Lime Scale